



















**C-V Ranches**

EPA PWS # 5600806

Service Area Population: 110

Water Supply: 2 Wells

Water Treatment: None

Wastewater Treatment: Individual Septic System

Monthly Water Rates: NA

Annual Water Use: 11,000 GPD

Per Capita Use: Ave. Day: 100 GPCPD

Peak Day Demand: (estimated) 38,500 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P53848W	Groundwater	9/2/1980	160 GPM	Primary domestic use
P53100W	Groundwater	1/7/1980	250 GPM	Fire Well

Municipal Water Right Capacity: 410 GPM

**Evans Mobile Home Court**

EPA PWS # 5600215

Service Area Population: 150

Water Supply: 2 Wells

Water Treatment: None

Wastewater Treatment: Individual Septic Systems

Annual Water Use: 18,000 GPD

Per Capita Use: Ave. Day: 120 GPCPD

Peak Day Demand: (estimated) 63,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P42289W	Groundwater	10/21/1977	50GPM	
P61730W	Groundwater	7/15/1982	50GPM	
P61731W	Groundwater	8/09/1982	0	Enlargement of 42289

Municipal Water Right Capacity: 100 GPM

**Fish Creek Improvement and Service District (formerly Wilson Meadows Water System)**

EPA PWS # 5601473

**Service Area Population:** 180

**Water Supply:**

**Water Treatment:** Hypochlorination is present but not currently being used except during annual fire hydrant testing.

**Wastewater Treatment:** Individual Septic Systems

**Annual Water Use:** Ave. Day: 31,500 GPD

**Per Capita Use:** Ave. Day: 175 GPCPD

**Peak Day Demand:** (estimated) 110,250 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P108615W	Groundwater	12/8/1997	256 GPM	
P108616W	Groundwater	12/8/1997	256 GPM	
P108617W	Groundwater	12/8/1997	750 GPM	
P108617W	Groundwater	12/8/1997	750 GPM	

**Municipal Water Right Capacity:** 2012 GPM

**Grand Teton National Park Colter Bay**

EPA PWS # 5680095

**Service Area Population:** 363

**Water Supply:** 2 wells per the sanitary survey. The survey does not provide a SEO water right permit for the second well.

**Water Treatment:** Sodium hypochlorite

**Wastewater Treatment:** NA

**Annual Water Use:** 109,000 GPD

**Per Capita Use:** 300 GPCPD

**Peak Day Demand:** (estimated) 382,000

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P842W	Groundwater	3/19/1962	150GPM	Backup for Jackson Lake Lodge
P30080W	Groundwater	4/23/1975	180GPM	Additional Supply/Primary well for Jackson Lake Lodge

**Municipal Water Right Capacity:** 150 GPM

**Grand Teton National Park Jackson Lake Lodge**

**EPA PWS #** 5680103

**Service Area Population:** 354

**Water Supply:** 2 Wells

**Water Treatment:** Sodium hypochlorite

**Wastewater Treatment:** NA

**Annual Water Use:** 106,000 GPD

**Per Capita Use:** 300 GPCPD

**Peak Day Demand:** (estimated) 371,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P30080W	Groundwater	4/23/1975	180GPM	
P842W	Groundwater	3/19/1962	150GPM	Backup for Jackson Lake Lodge

**Municipal Water Right Capacity:** 180 GPM

**Grand Teton National Park Moose Beaver Creek**

**EPA PWS #** 5680093

**Service Area Population:** 389

**Water Supply:** 2 wells are reported in the sanitary survey (Taggart Wells #1 and #2). Only the Taggart #2 appears in the State Engineer’s Office database.

**Water Treatment:** Sodium hypochlorite

**Wastewater Treatment:** NA

**Annual Water Use:** 22,200 GPD

**Per Capita Use:** 57 GPCPD

**Peak Day Demand:** (estimated) 77,700 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P117801W	Groundwater	7/12/1999	100GPM	

**Municipal Water Right Capacity:** 100GPM

**Gros Ventre North HOA**

EPA PWS # 5601357

Service Area Population: 200

Water Supply: 3 Wells

Water Treatment: NA

Wastewater Treatment: Individual Septic Systems

Annual Water Use: 150,000 GPD

Per Capita Use: 750 GPCPD

Peak Day Demand: (estimated) 525,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P79145W	Groundwater	2/21/1989	70GPM	(1)
P84278W	Groundwater	1/9/1991	100GPM	Gros Ventre #2
P161095W	Groundwater	7/8/2004	200GPM	Gros Ventre #3
P113293W	Groundwater	12/3/1998	30GPM	1 <sup>st</sup> Enl Gros Ventre #1 (incomplete)
P113294W	Groundwater	12/3/1998	50GPM	1 <sup>st</sup> Enl Gros Ventre #2

*(1) Incomplete Status SEO / reported out of service in 2009 Sanitary survey.*

**Municipal Water Right Capacity:** 450 GPM if all wells in service

**Gros Ventre Butte West (Bar Y Estates)**

EPA PWS # 5600976

Service Area Population: 270

Water Supply: 2 Wells

Water Treatment: Sodium Hypochlorite

Wastewater Treatment: Individual Septic Systems

Annual Water Use: 32,400 GPD

Per Capita Use: 120 GPCPD

Peak Day Demand: (estimated) 113,400 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P79736W	Groundwater	5/8/1989		
P147767W	Groundwater	9/27/2002	80GPM	

**Municipal Water Right Capacity:** 175 GPM

**High Country Subdivision**

EPA PWS # 5600216

Service Area Population: 78

Water Supply: 2 Wells

Water Treatment: NA

Wastewater Treatment: Individual Septic Systems

Annual Water Use: 9,360 GPD

Per Capita Use: 120 GPCPD

Peak Day Demand: (estimated) 32,760 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P2504W	Groundwater	12/13/1968	60GPM	No status per SEO
P63779W	Groundwater	4/11/1983	0	Enl. P2504W
P52147W	Groundwater	5/12/1980	25GPM	
P60153W	Groundwater	10/19/1981	175GPM	Enl. P52147W
P63780W	Groundwater	4/11/1983	0	Enl. P52147W – Status

**Municipal Water Right Capacity:** 260 GPM

Per State Engineer’s Office; these wells are all comingled.  
P63780W is the only well reported in the sanitary survey.  
Comments all per State Engineer’s Office database.

**Highland Park Subdivision**

Not considered an EPA community water system

DRAFT

## Indian Paintbrush

EPA PWS # 5600758

**Service Area Population:** 150

**Water Supply:** 2 wells per the sanitary survey

**Water Treatment:** Sodium Hypochlorite

**Wastewater Treatment:** Individual Septic Systems

**Annual Water Use:** 44,250 GPD

**Per Capita Use:** 295 GPCPD

**Peak Day Demand:** (estimated) 155,000 GPD

### **Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P71524W	Groundwater	11/14/1985	45GPM	Incomplete
P121470W	Groundwater	12/13/1999	90GPM	Incomplete
P24269D	Surface water	6/5/1973	0.96CFS	
P6774E	Surface water	2/26/1979	0	Enl P24269D

*(1) Comingled with following water rights per SEO database.*

**Municipal Water Right Capacity:** 135GPM

P71542W and P121470 are the only water sources reported in the sanitary survey. The other water rights came up in the State Engineer's database research. It is unknown if they are being exercised. However, it is assumed they are not being used for determination of the water right capacity.

## Indian Springs

Not considered an EPA community water system

**Jackson Hole Golf and Tennis (Gros Ventre Utility)**

EPA PWS # 5600027

Service Area Population: 97

Water Supply: 4 Wells

Water Treatment: No treatment

Wastewater Treatment: Jackson sanitary sewer system

Annual Water Use: 192,000 GPD

Per Capita Use: 1,980 GPCPD

Peak Day Demand: (estimated) 672,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P98396W	Groundwater	3/2/1995	15GPM	Incomplete
P158923W	Groundwater	4/22/2004	250GPM	Incomplete
P158924W	Groundwater	4/22/2004	250GPM	Incomplete
P158925W	Groundwater	4/22/2004	1500GPM	Incomplete
P158926W	Groundwater	4/22/2004	1500GPM	Incomplete

*(1) Sanitary survey reports as abandoned.*

**Municipal Water Right Capacity:** 3500 GPM

**J-W Subdivision**

EPA PWS # 5600877

Service Area Population: 38

Water Supply: 2 Wells

Water Treatment: Hypochlorite

Wastewater Treatment: Individual Septic Systems

Annual Water Use: 4,560 GPD

Per Capita Use: Ave. Day: 120 GPCPD

Peak Day Demand: (estimated) 15,960 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P60074W	Groundwater	4/24/1981	40GPM	
P77828W	Groundwater	8/16/1988	20GPM	

**Municipal Water Right Capacity:** 60 GPM

**Little Horsethief Canyon**

Not considered an EPA community water system

**Melody Ranch**

**EPA PWS #** 5601440

**Service Area Population:** 500

**Water Supply:** 2 Wells

**Water Treatment:** Gaseous Chlorination

**Wastewater Treatment:** Town of Jackson Treatment Plant, surface discharge into Snake River drainage.

**Annual Water Use:** 320,000 GPD

**Per Capita Use:** Ave. Day: 640 GPCPD

**Peak Day Demand:** (estimated) 1,120,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P193269W	Groundwater	6/25/2010	400GPM	Refiling of cancelled P120237W
P193270W	Groundwater	6/25/2010	400GPM	Refiling of cancelled P120238W

**Municipal Water Right Capacity:** 800 GPM



**Millward Trailer Park**

Not considered an EPA community water system

**Rafter J Subdivision HOA**

**EPA PWS #** 5600822

**Service Area Population:** 1250

**Water Supply:** 4 Wells

**Water Treatment:** Gaseous Chlorination

**Wastewater Treatment:** Town of Jackson Treatment Plant, surface discharge into Snake River drainage.

**Annual Water Use:** Ave. Day: 800,000 GPD

**Per Capita Use:** Ave. Day: 640 GPCPD

**Peak Day Demand:** (estimated) 2.8 MGD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P48096W	Groundwater	4/4/1979	350GPM	
P90512W	Groundwater	12/29/1992	500 GPM	
P93364W	Groundwater	8/18/1993	100 GPM	Enl P48096W
P118543W	Groundwater	8/25/1999	300 GPM	
P193707W	Groundwater	8/6/2010	350 GPM	

**Municipal Water Right Capacity:** 1600 GPM

**River Meadows H.O.A**

EPA PWS # 5600786

Service Area Population: 120

Water Supply: 3 Wells

Water Treatment: None

Wastewater Treatment: Individual Septic Systems

Annual Water Use: Ave. Day: 15,000 GPD

Per Capita Use: Ave. Day: 125 GPCPD

Peak Day Demand: (estimated) Ave. Day: 52,500 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P93174W	Groundwater	8/25/1993	150 GPM	
P129019W	Groundwater	9/5/2000	150 GPM	
P139237W	Groundwater	8/29/2001	85 GPM	

Municipal Water Right Capacity: 385 GPM

**Saddle Butte Subdivision**

Not considered an EPA community water system

DRAFT

**Skyline Ranch Improvement and Service District**

EPA PWS # 5600217

Service Area Population: 160

Water Supply: 2 Wells

Water Treatment: None

Wastewater Treatment: Individual Septic Systems

Annual Water Use: Ave. Day: 76,640 GPD

Per Capita Use: Ave. Day: 479 GPCPD

Peak Day Demand: (estimated) 268,240 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P2248W	Groundwater	5/15/1968	100 GPM	(1)
P159621W	Groundwater	6/3/2004	225 GPM	
P179020W	Groundwater	4/24/2006	250 GPM	

*(1) Sanitary Survey says no longer used but there is a valid water right at the State Engineer's Office*

Municipal Water Right Capacity: 475 GPM

**Snake River Mobile Home Park**

EPA PWS # 5600214

Service Area Population: 65

Water Supply: 1 Well

Water Treatment: Hypochloride chlorination, as required by EPA because of the influence of surface water on well

Wastewater Treatment: Individual Septic Systems

Annual Water Use: 4,875 GPD

Per Capita Use: Ave. Day: 75 GPCPD

Peak Day Demand: (estimated) 17,062 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P148353W	Groundwater	8/12/2002	25 GPM	
P51149W	Groundwater	12/19/1979	25 GPM	
P95669W	Groundwater	4/4/1994	25 GPM	
P95670W	Groundwater	4/4/1994	25 GPM	

Municipal Water Right Capacity: 25 GPM

Note: Per the 2010 Sanitary Survey, only well P148353W is being used. The other three wells have a valid water right with the Wyoming State Engineer's Office so were.

**South Park Village Subdivision**

EPA PWS # 5600836

Service Area Population: 80

Water Supply: 1 Well

Water Treatment: Hypochlorite injector at wellhouse

Wastewater Treatment: Individual Septic Systems

Annual Water Use: 10,400 GPD

Per Capita Use: Ave. Day: 130 GPCPD

Peak Day Demand: (estimated) 36,400 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P119494W	Groundwater	8/10/1999	100GPM	

Municipal Water Right Capacity: 100GPM

**Spring Creek Improvement District**

EPA PWS # 5600811

Service Area Population: 500

Water Supply: 2 Wells

Water Treatment: Chlorine gas

Wastewater Treatment: Town of Jackson treatment plant

Annual Water Use: 262,500 GPD

Per Capita Use: 525 GPCPD

Peak Day Demand: (estimated) 918,750GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P96458W	Groundwater	7/20/94	400 GPM	
P96459W	Groundwater	7/20/94	800 GPM	

Municipal Water Right Capacity: 1200 GPM

DRAFT

**Squaw Creek Water District**

EPA PWS # 5600737

Service Area Population: 160

Water Supply: 1 Spring & 2 Wells

Water Treatment: Sodium hypochlorite

Wastewater Treatment: Individual Septic Systems

Annual Water Use: Ave. Day: 20,000 GPD

Per Capita Use: Ave. Day: 125 GPCPD

Peak Day Demand: (estimated) 70,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P102953W	Groundwater	7/5/1996	40 GPM	
P102954W	Groundwater	7/5/1996	35 GPM	
P27641D	Surface Water	12/29/1981	0.11CFS	

Municipal Water Right Capacity: 124 GPM

**Targhee Towne Water Co., Inc.**

EPA PWS # 5600787

Service Area Population: 120

Water Supply: 3 Wells

Water Treatment: Intermittent chlorination

Wastewater Treatment: Individual Septic Systems

Annual Water Use: Ave. Day: 14,400 GPD

Per Capita Use: Ave. Day: 120 GPCPD

Peak Day Demand: (estimated) 50,400 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P12797W	Groundwater	1/14/1972	250 GPM	
P179516W	Groundwater	1/12/2007	100 GPM	
P179517W	Groundwater	1/12/2007	225 GPM	
P189947W	Groundwater	12/29/2008	0GPM	Enl. P12797W
P189948W	Groundwater	12/29/2008	0GPM	Enl. P179517W
P189949W	Groundwater	12/29/2008	50GPM	

Municipal Water Right Capacity: 625 GPM

The 2011 Sanitary Survey reports P163462W, P179516W and P179517 as the only wells being used. P163462W is cancelled per the SEO records. The other permits are in the SEO database so were included.

**Targhee Village**

Not considered an EPA community water system

**Teton Shadows HOA**

**EPA PWS #** 5600724

**Service Area Population:** 50

**Water Supply:** 1 Well

**Water Treatment:** Water is not currently treated but UV and chlorine disinfection is online.

**Wastewater Treatment:** Connected to City of Jackson sewer system.

**Annual Water Use:** Ave. Day: 6,000 GPD

**Per Capita Use:** Ave. Day: 120 GPCPD

**Peak Day Demand:** (estimated) 21,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P15642W	Groundwater	7/13/1972	50 GPM	

**Municipal Water Right Capacity:** 50 GPM

DRAFT

**Teton Village Water and Sewer District**

EPA PWS # 5600218

Service Area Population: 660

Water Supply: Sanitary Survey reports 2 wells. SEO database has 4 permitted wells.

Water Treatment: Gas chlorination is on line, but continuous disinfection is not practiced

Wastewater Treatment: Centralized septic systems

Annual Water Use: Ave. Day: 260,700GPD

Per Capita Use: Ave. Day: 395 GPCPD

Peak Day Demand: (estimated) 912,450 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P32547W	Groundwater	3/17/1976	350 GPM	
P100142W	Groundwater	3/17/1994	1000 GPM	
P100143W	Groundwater	3/17/1994	1000 GPM	
P5890W	Groundwater	6/22/1970	75 GPM	

Municipal Water Right Capacity: 2,425 GPM

Note: The 2009 Sanitary Survey only reported wells P32547W and P100142W as being used.

**Town of Jackson**

EPA PWS # 5600213

Service Area Population: 12,000

Water Supply: 7 Wells

Water Treatment: Chlorine disinfection at all wells

Wastewater Treatment: Centralized sewer system and treatment facility

Annual Water Use: Ave. Day: 2,148,000 GPD

Per Capita Use: Ave. Day: 179 GPCPD

Peak Day Demand: (estimated) 7,581,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P1385W	Groundwater	12/18/1964	950 GPM	Well #1
P1386W	Groundwater	12/18/1964	700 GPM	Well #2
P1945W	Groundwater	4/4/1967	700 GPM	Well #3
P2055W	Groundwater	7/6/1967	950 GPM	Well #2
P69746W	Groundwater	4/5/1985	2500 GPM	Well #5
P85495W	Groundwater	6/27/1991	100 GPM	Enl. Well #2
P85496W	Groundwater	6/27/1991	75 GPM	Enl. Well #3
P101360W	Groundwater	4/17/1995	1300 GPM	Well #6
P101361W	Groundwater	4/17/1995	1300 GPM	Well #7
P101362W	Groundwater	4/17/1995	1300 GPM	Well #8
P104232W	Groundwater	4/8/1996	0 GPM	1 <sup>st</sup> Enl Well #1
P104233W	Groundwater	4/18/1996	0 GPM	Enl Well #2
P104234W	Groundwater	4/18/1996	0 GPM	Enl. Well #3
P104235W	Groundwater	4/18/1996	0 GPM	Enl. Well #5

Municipal Water Right Capacity: 9,875 GPM

**Valley View Mutual Water Company**

EPA PWS # 5601499

Service Area Population: 60

Water Supply: Well

Water Treatment: Individual Septic

Wastewater Treatment: Sodium hypochlorite

Annual Water Use: Ave. Day: 13,800 GPD

Per Capita Use: Ave. Day: 230 GPCPD

Peak Day Demand: (estimated) 48,300 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P124365W	Groundwater	3/3/2000	20 GPM	

Municipal Water Right Capacity: 20 GPM

**Town of Afton**

EPA PWS # 5600002

Service Area Population: 1818

Water Supply: Wells and Springs

Water Treatment: Gas Chlorination

Wastewater Treatment: Centralized Septic

Annual Water Use: Ave. Day: 1,370,772 GPD

Per Capita Use: Ave. Day: 754 GPCPD

Peak Day Demand: (estimated) 4,797,702 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P6663D	Spring	4/17/1905	0.42 CFS	
Various	Spring	Various	4.65086 CFS	
Various	Spring	Various	1.7091CFS	
P12154D	Spring	10/29/1913	2.5 CFS	
P65653W	Groundwater	4/17/1983	150 GPM	
P65655W	Groundwater	10/5/1983	150 GPM	
P86364W	Groundwater	9/27/1991	900 GPM	
P7010E	Spring	2/27/1991	7.15 CFS	Enl Afton Water Works Pipe
P91531W	Groundwater	2/11/1993	200 GPM	Enl P86364W
P172886W	Groundwater	12/9/2005	1200 GPM	

Municipal Water Right Capacity: 9974 GPM



**Town of Alpine**

EPA PWS # 5600156

Service Area Population: 700

Water Supply: Wells

Water Treatment: Sodium Hypochlorite

Wastewater Treatment: Centralized wastewater system for 70%, remaining 30% use onsite septic

Annual Water Use: Ave. Day: 224,000 GPD

Per Capita Use: Ave. Day: 320 GPCPD

Peak Day Demand: (estimated) 784,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P24104D	Surface Water	7/9/1973	1.75 CFS	
P39163W	Groundwater	7/20/1977	200 GPM	
P78067W	Groundwater	12/27/1985	100 GPM	Enl. P39163W
P6910E	Surface Water	12/27/1985	1.75 CFS	
P77717W	Groundwater	6/23/1988	375 GPM	
P98662W	Groundwater	3/27/1995	50 GPM	Enl. P39163W
P189882W	Groundwater	10/23/2008	350 GPM	Incomplete 3 <sup>rd</sup> Enl P39163W
P189883W	Groundwater	10/23/2008	350 GPM	Incomplete 1 <sup>st</sup> Enl P77717W
P198240W	Groundwater	1/3/2012	700 GPM	Unadjudicated

Municipal Water Right Capacity: 3696 GPM

**Bedford Water and Sewer District**

EPA PWS # 5600006

Service Area Population: 1200

Water Supply: Surface Water and Groundwater

Water Treatment: Chlorination available but not used

Wastewater Treatment: Individual Septic Systems

Annual Water Use: Ave. Day: 399,600 GPD

Per Capita Use: Ave. Day: 333 GPCPD

Peak Day Demand: (estimated) 1,398,600 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P20014D	Spring	7/03/1945	0.613 CFS	
P4521E	Surface Water	3/26/1923	1.5 CFS	
P81829W	Groundwater	1/31/1990	300 GPM	
P30370D	Spring	6/2/1989	0.6 CFS	
P6961E	Spring	6/2/1989	1.517 CFS	Enl. 20014D

Municipal Water Right Capacity: 1248 GPM

**Etna Water and Sewer District**

EPA PWS # 5600157

**Service Area Population:** 120

**Water Supply:** Wells and Springs

**Water Treatment:** None

**Wastewater Treatment:** Individual Septic

**Annual Water Use:** Ave. Day: 21,600 GPD

**Per Capita Use:** Ave. Day: 180 GPCPD

**Peak Day Demand:** (estimated) 75,600 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P6984D	Spring	11/13/1905	0.39CFS	
P7790D	Spring	6/1/1907	0.83 CFS	
P18930D	Spring	8/21/1937	0.058 CFS	
P139351W	Groundwater	9/24/2001	400 GPM	

**Municipal Water Right Capacity:** 974 GPM

**Fairview Water and Sewer District**

EPA PWS # 5600166

**Service Area Population:** 250

**Water Supply:** Well and Spring

**Water Treatment:** None

**Wastewater Treatment:** Individual septic

**Annual Water Use:** Ave. Day: 60,000 GPD

**Per Capita Use:** Ave. Day: 240 GPCPD

**Peak Day Demand:** (estimated) 210,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P93172W	Groundwater	7/30/1993	255 GPM	
P17137D	Spring	6/8/1926	0.04 CFS	

**Municipal Water Right Capacity:** 273 GPM

**Freedom Water and Sewer District**

**EPA PWS #** 5600158

**Service Area Population:** 300

**Water Supply:** Well

**Water Treatment:** Disinfection available but not used

**Wastewater Treatment:** Individual septic

**Annual Water Use:** Ave. Day: 103,500 GPD

**Per Capita Use:** Ave. Day: 345 GPCPD

**Peak Day Demand:** (estimated) 362,250 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P101707W	Groundwater	2/23/1996	400 GPM	

**Municipal Water Right Capacity:** 400 GPM

**Greater Smoot Water & Sewer District**

**EPA PWS #** 5601397

**Service Area Population:** 260

**Water Supply:** Springs and Well

**Water Treatment:** None

**Wastewater Treatment:** Individual septic

**Annual Water Use:** Ave. Day: 28,600 GPD

**Per Capita Use:** Ave. Day: 110 GPCPD

**Peak Day Demand:** (estimated) 100,100 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P19293D	Spring	11/30/1939	0.076 CFS*	
P5302E	Spring	12/15/1940	0.274 CFS*	1 <sup>st</sup> Enl. 19293D
P7172E	Spring	10/3/1995	2.09 CFS*	Forks Springs Enl.
P7173E	Spring	10/3/1995	2.09 CFS*	Forks Springs Enl. #2
P101115W	Groundwater	10/30/1995	500 GPM	

\*The flow is not to exceed 2.09 cfs.

**Municipal Water Right Capacity:** 1438 GPM

**Grover Water and Sewer District**

EPA PWS # 5600160

Service Area Population: 400

Water Supply: Well and Spring

Water Treatment: Disinfection on site but not used

Wastewater Treatment: Individual Septic

Annual Water Use: Ave. Day: 60,400 GPD

Per Capita Use: Ave. Day: 151 GPCPD

Peak Day Demand: (estimated) 211,400 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P18543D	Spring	1/10/1935	0.022 CFS	
P6744E	Spring	1/03/1978	0.24 CFS	
P 93173W	Groundwater	7/30/1993	270 GPM	
P64767W	Groundwater	7/11/1983	10 GPM	

Municipal Water Right Capacity: 398 GPM

**Happy Valley Pipeline Company**

EPA PWS # 5600153

Service Area Population: 80

Water Supply: Springs

Water Treatment: None

Wastewater Treatment: Individual Septic

Annual Water Use: Ave. Day: 29,360 GPD

Per Capita Use: Ave. Day: 367 GPCPD

Peak Day Demand: (estimated) 102,760 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P22655D	Spring	5/09/1966	0.361 CFS*	
P6852E	Spring	7/12/1978		Enl. P22655D
P6853E	Spring	1/15/1987		Enl. P22655D
P24245D	Spring	12/03/1973		
P6854E	Spring	1/15/1987		Enl. P24245D

\* Note: Combined use for all permits not to exceed 0.361 cfs.

Municipal Water Right Capacity: 162 GPM

**Kennington Springs Pipeline Company**

EPA PWS # 5601199

Service Area Population: 75

Water Supply: Spring

Water Treatment: None

Wastewater Treatment: Individual septic

Annual Water Use: Ave. Day: 9,000 GPD

Per Capita Use: Ave. Day: 120 GPCPD

Peak Day Demand: (estimated) 31,500 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P29906D	Spring	4/08/1988	1.105 CFS*	
P29907D	Spring	4/08/1988		

\*Note: Combined use for both permits not to exceed 1.105 cfs.

Municipal Water Right Capacity: 496 GPM

**Nordic Ranches Subdivision**

EPA PWS # 5601418

Service Area Population: 605

Water Supply: Groundwater

Water Treatment: None

Wastewater Treatment: Individual septic

Annual Water Use: Ave. Day: 59,895 GPD

Per Capita Use: Ave. Day: 99 GPCPD

Peak Day Demand: (estimated) 209,632 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P76226W	Groundwater	1/11/1988	20 GPM	
P95148W	Groundwater	3/8/1993	10 GPM	Enl. P76226W
P100147W	Groundwater	8/7/1995	85 GPM	2 <sup>nd</sup> Enl. P76226W
P108464W	Groundwater	12/22/1997	120 GPM	
P179589W	Groundwater	2/16/2006	85 GPM	

Municipal Water Right Capacity: 320 GPM

**North Alpine Improvement and Service District**

EPA PWS # 5601021

Service Area Population: 118

Water Supply: Wells

Water Treatment: None

Wastewater Treatment: Individual septic

Annual Water Use: Ave. Day: 29,972 GPD

Per Capita Use: Ave. Day: 254 GPCPD

Peak Day Demand: (estimated) 104,902 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P102467W	Groundwater	3/14/1988	40 GPM	Incomplete
P102468W	Groundwater	3/14/1988	50 GPM	Incomplete
P175535W	Groundwater	5/4/2006	15 GPM	1 <sup>st</sup> enlargement P102468W
P160002W	Groundwater	7/15/2003	65 GPM	Unadjudicated
P160003W	Groundwater	7/15/2003	65 GPM	Unadjudicated
P183449W	Groundwater	8/27/2007	100 GPM	Incomplete

Municipal Water Right Capacity: 335 GPM

**North Star Utility**

EPA PWS # 5601613

Service Area Population: 32

Water Supply: Wells

Water Treatment: None

Wastewater Treatment: Individual septic

Annual Water Use: Ave. Day: 10,351 GPD

Per Capita Use: Ave. Day: 320 GPCPD

Peak Day Demand: (estimated) 36,229 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P101241W	Groundwater	12/12/1995	30 GPM	
P101242W	Groundwater	12/12/1995	50 GPM	
P178318W	Groundwater	9/12/2006	50 GPM	1 <sup>st</sup> Enl. P101241W
P178319W	Groundwater	9/12/2006	50 GPM	1 <sup>st</sup> Enl. P101242W
P182139W	Groundwater	6/12/2007	200 GPM	2nd Enl. P101241W
P182140W	Groundwater	6/12/2007	200 GPM	2nd Enl. P101242W

Municipal Water Right Capacity: 580 GPM

**Osmond, Community of**

EPA PWS # 5600154

Service Area Population: 250

Water Supply: Spring

Water Treatment: None

Wastewater Treatment: Individual Septic

Annual Water Use: Ave. Day: 504,000 GPD

Per Capita Use: Ave. Day: 2,016 GPCPD

Peak Day Demand: (estimated) 1,764,000 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P17657D	Water Cress Spring #1	09/25/1929	0.50 CFS	Not used
P22599D	Osmond Spring	11/17/1961	0.50 CFS	Additional supply

Municipal Water Right Capacity: 0.5 cfs

**Star Valley Ranch Association**

EPA PWS # 5600287

Service Area Population: 1,334

Water Supply: Springs and Wells

Water Treatment: None

Wastewater Treatment: Individual septic

Annual Water Use: Ave. Day: 1,000,500 GPD

Per Capita Use: Ave. Day: 750 GPCPD

Peak Day Demand: (estimated) 3,501,750 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P13319W	Groundwater	4/16/1971	325 GPM	
P28143D	Spring	9/9/1982	2.22 CFS*	
P6973E	Spring	7/16/1987	2.22 CFS*	
P6974E	Spring	9/8/1989	2.22 CFS*	
P90328W	Groundwater	11/30/1992	500 GPM	
P120239W	Groundwater	5/28/1999	300 GPM	
P193033W	Groundwater	2/11/2009	300 GPM	
P193487W	Groundwater	8/2/2010	500 GPM	

\*Combined flow = 2.22 CFS

Municipal Water Right Capacity: 2,921 GPM

**Star Valley Ranch RV Park / Bridger View Ranches**

**EPA PWS #:** No sanitary survey available

**Service Area Population:** 900

**Water Supply:** Wells

**Water Treatment:** None

**Wastewater Treatment:** Lagoon

**Annual Water Use:** Ave. Day: 67,500 GPD

**Per Capita Use:** Ave. Day: 75 GPCPD

**Peak Day Demand:** (estimated) 236,250 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P89402W	Groundwater	08/28/1992	300 GPM	
P137210W	Groundwater	08/01/2001	325 GPM	

**Municipal Water Right Capacity:** 625 GPM

**Star Valley Trailer Court**

**EPA PWS #** 5601017

**Service Area Population:** 90

**Water Supply:** Well

**Water Treatment:** None

**Wastewater Treatment:** Individual septic

**Annual Water Use:** Ave. Day: 7,200 GPD

**Per Capita Use:** Ave. Day: 80 GPCPD

**Peak Day Demand:** (estimated) 25,200GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P92378W	Groundwater	07/06/1993	22 GPM	

**Municipal Water Right Capacity:** 22 GPM

DRAFT



**Star View Estates**

**EPA PWS #** 5600893

**Service Area Population:** 79

**Water Supply:** Well

**Water Treatment:** None

**Wastewater Treatment:** Individual septic

**Annual Water Use:** Ave. Day: 9,480 GPD

**Per Capita Use:** Ave. Day: 120 GPCPD

**Peak Day Demand:** (estimated) 33,180 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P59978W	Groundwater	4/21/1981	100 GPM	

**Municipal Water Right Capacity:** 100 GPM

**Town of Thayne**

**EPA PWS #** 5600159

**Service Area Population:** 351

**Water Supply:** Spring and Well

**Water Treatment:** Chlorination

**Wastewater Treatment:** Lagoon

**Annual Water Use:** Ave. Day: 268,515 GPD


**Per Capita Use:** Ave. Day: 765 GPCPD

**Peak Day Demand:** (estimated) 939,802 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P20138D	Spring	7/29/1947	1.77 CFS	
P20255D	Spring	1/8/1949	0.27 CFS	
P20256D	Spring	1/8/1949	0.60 CFS	
P130958W	Groundwater	6/2/2000	650 GPM	

**Municipal Water Right Capacity:** 1,835 GPM

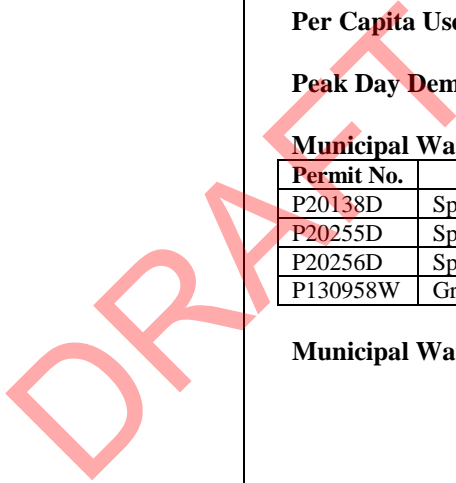

**Trail Ridge Water System**

EPA PWS # 5601576

Service Area Population: 59

Water Supply: Well

Water Treatment: None

Wastewater Treatment: Individual septic

Annual Water Use: Ave. Day: 7,080 GPD

Per Capita Use: Ave. Day: 120 GPCPD

Peak Day Demand: (estimated) 24,780 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P152037W	Groundwater	5/22/2003	80 GPM	
P152038W	Groundwater	5/22/2003	80 GPM	

Municipal Water Right Capacity: 160 GPM

**Turnerville Water and Sewer District (formerly Willow Ck Pipeline Co.)**

EPA PWS # 5601115

Service Area Population: 90

Water Supply: Spring

Water Treatment: None

Wastewater Treatment: Individual septic

Annual Water Use: Ave. Day: 9,990 GPD

Per Capita Use: Ave. Day: 111 GPCPD

Peak Day Demand: (estimated) 34,965 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P22811D	Spring	07/18/1967	0.288 CFS	

Municipal Water Right Capacity: 130 GPM

DRAFT

**Westview Village**

**EPA PWS #** 5600864

**Service Area Population:** 83

**Water Supply:** Well

**Water Treatment:** None

**Wastewater Treatment:** Individual septic

**Annual Water Use:** Ave. Day: 9,462 GPD

**Per Capita Use:** Ave. Day: 114 GPCPD

**Peak Day Demand:** (estimated) 33,117 GPD

**Municipal Water Rights:**

Permit No.	Source	Priority	Amount	Comments
P41356W	Groundwater	08/03/1977	25 GPM	

**Municipal Water Right Capacity:** 25 GPM

DRAFT